



AKS.037.200.000 SV

Pic.1 Crimp connector

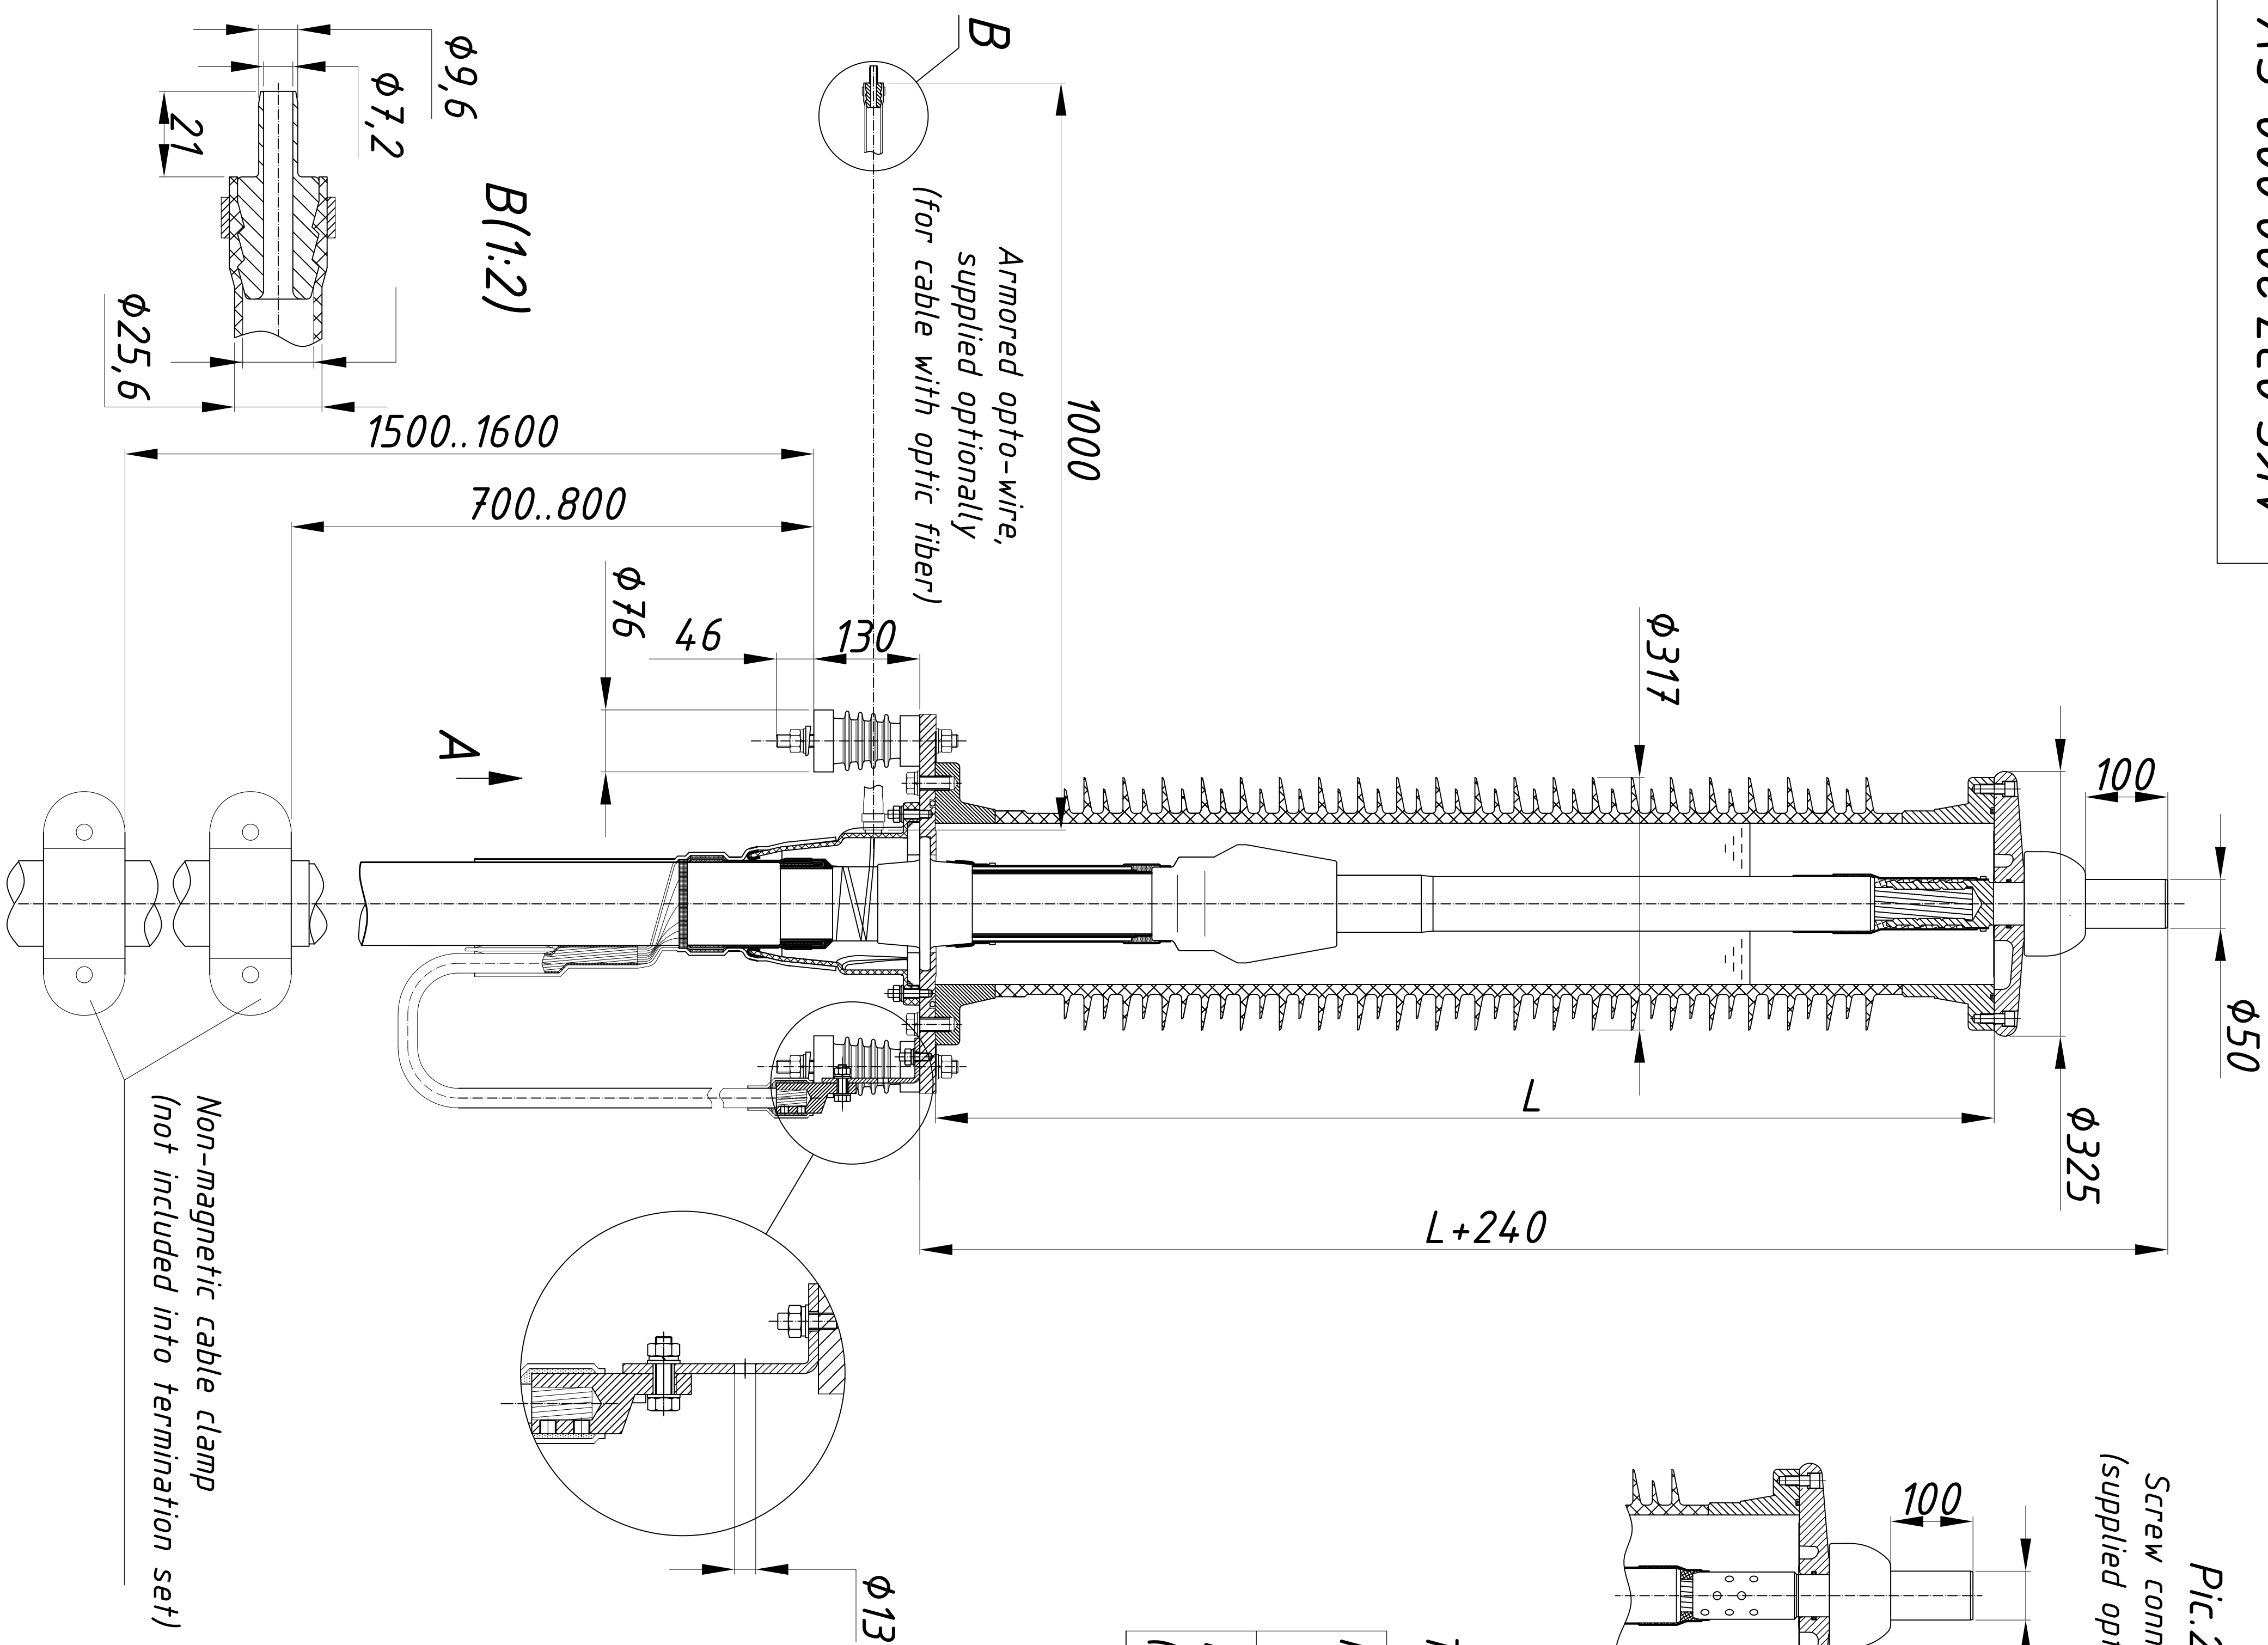

Pic.2

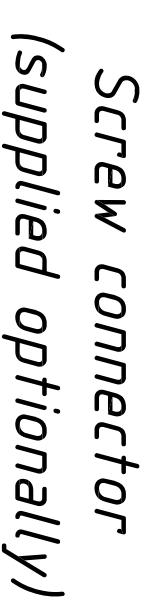

Pic.3

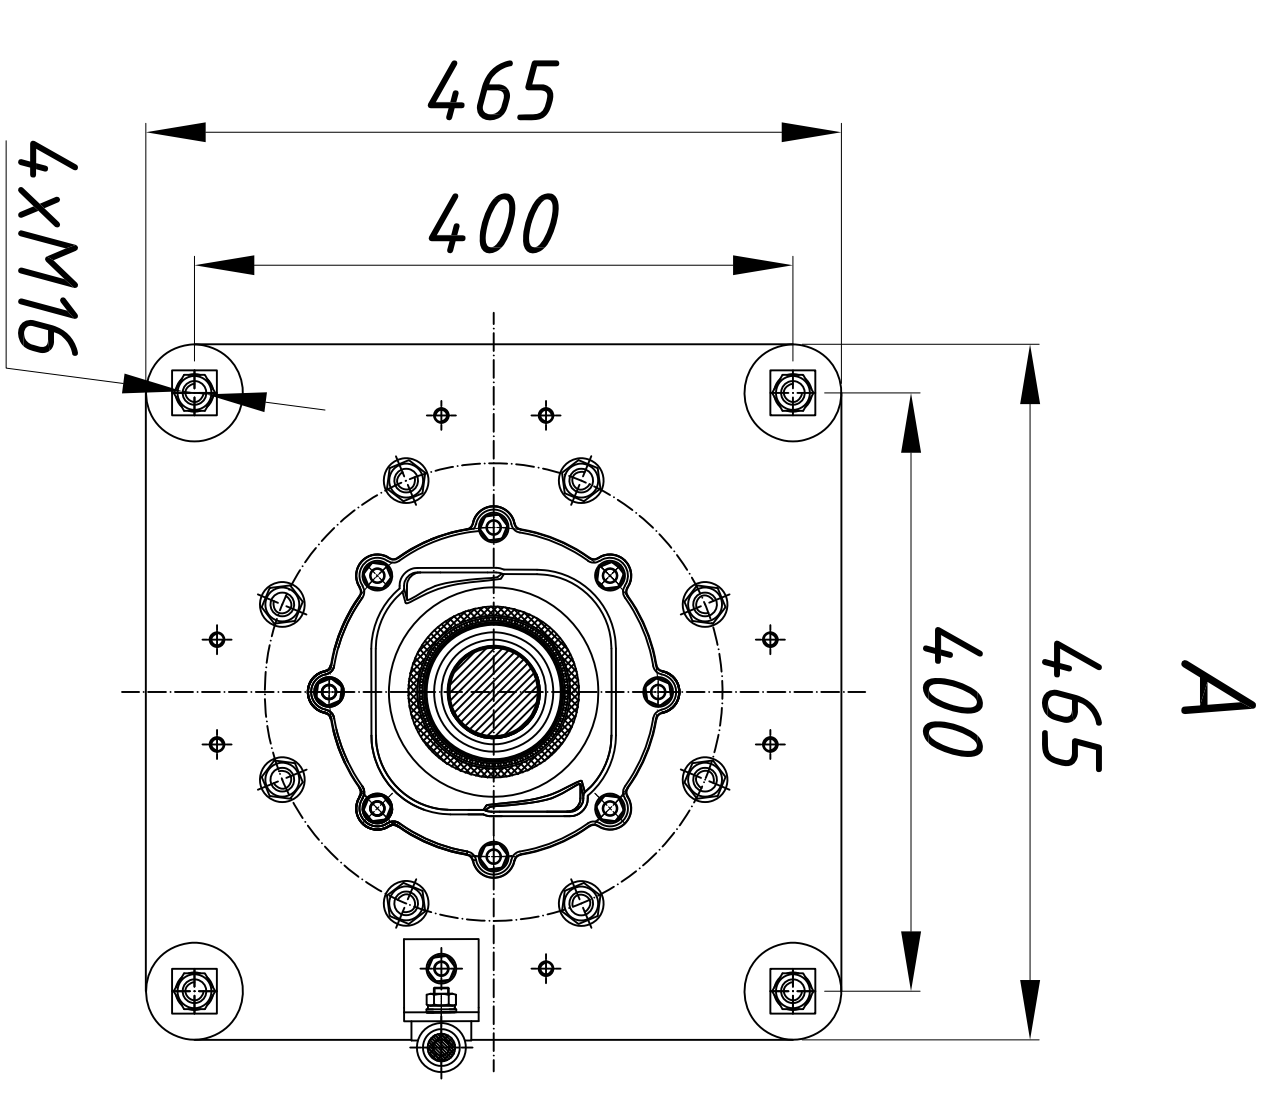
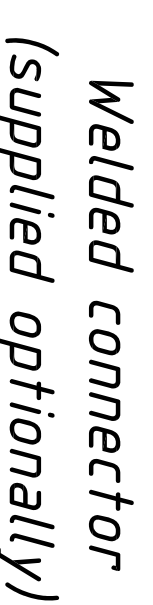


Table 1

Name	Pollution level IEC 60815		Minimal creepage distance, mm	L, mm
MKB 145	3870	III	3870	1365
(MKB 145 0)*	4025	IV	4605	1390

Table 2

Name	Performance
MKB 145 (MKB 145 O)*	Pic.1
MKB 145 B (MKB 145 BO)*	Pic.2
MKB 145 M (MKB 145 MO)*	Pic.3

1. * For cable with optic fiber.

				AKS.037.200.000 SV			
Ch. List	Nedoc.	Sign.	Date	High-voltage cable termination MKB 145 / MKB 145 O *			
Develop	Terekhov		09.06. 2020				
Check	Kintyukhin		09.06. 2020				
				Simple view			
Approve	Kintyukhin		09.06. 2020	Arkasil SK LLC			