
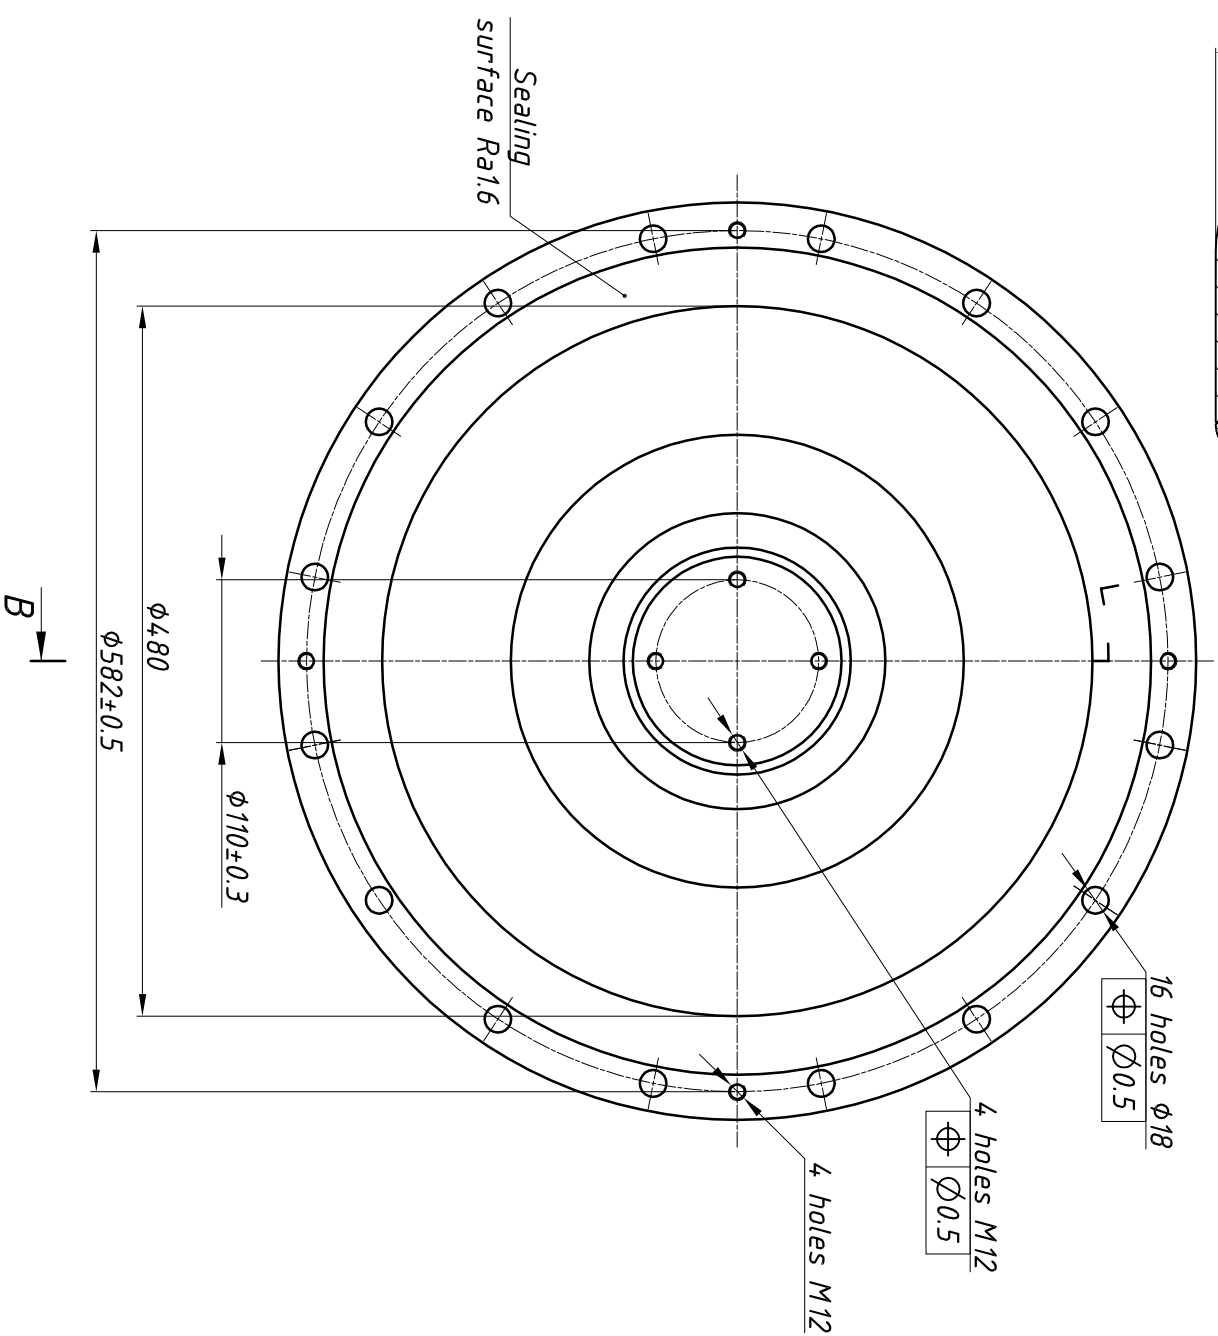


Fasteners and O-Ring seals are supplied by transformer manufacturer according to EN 50299

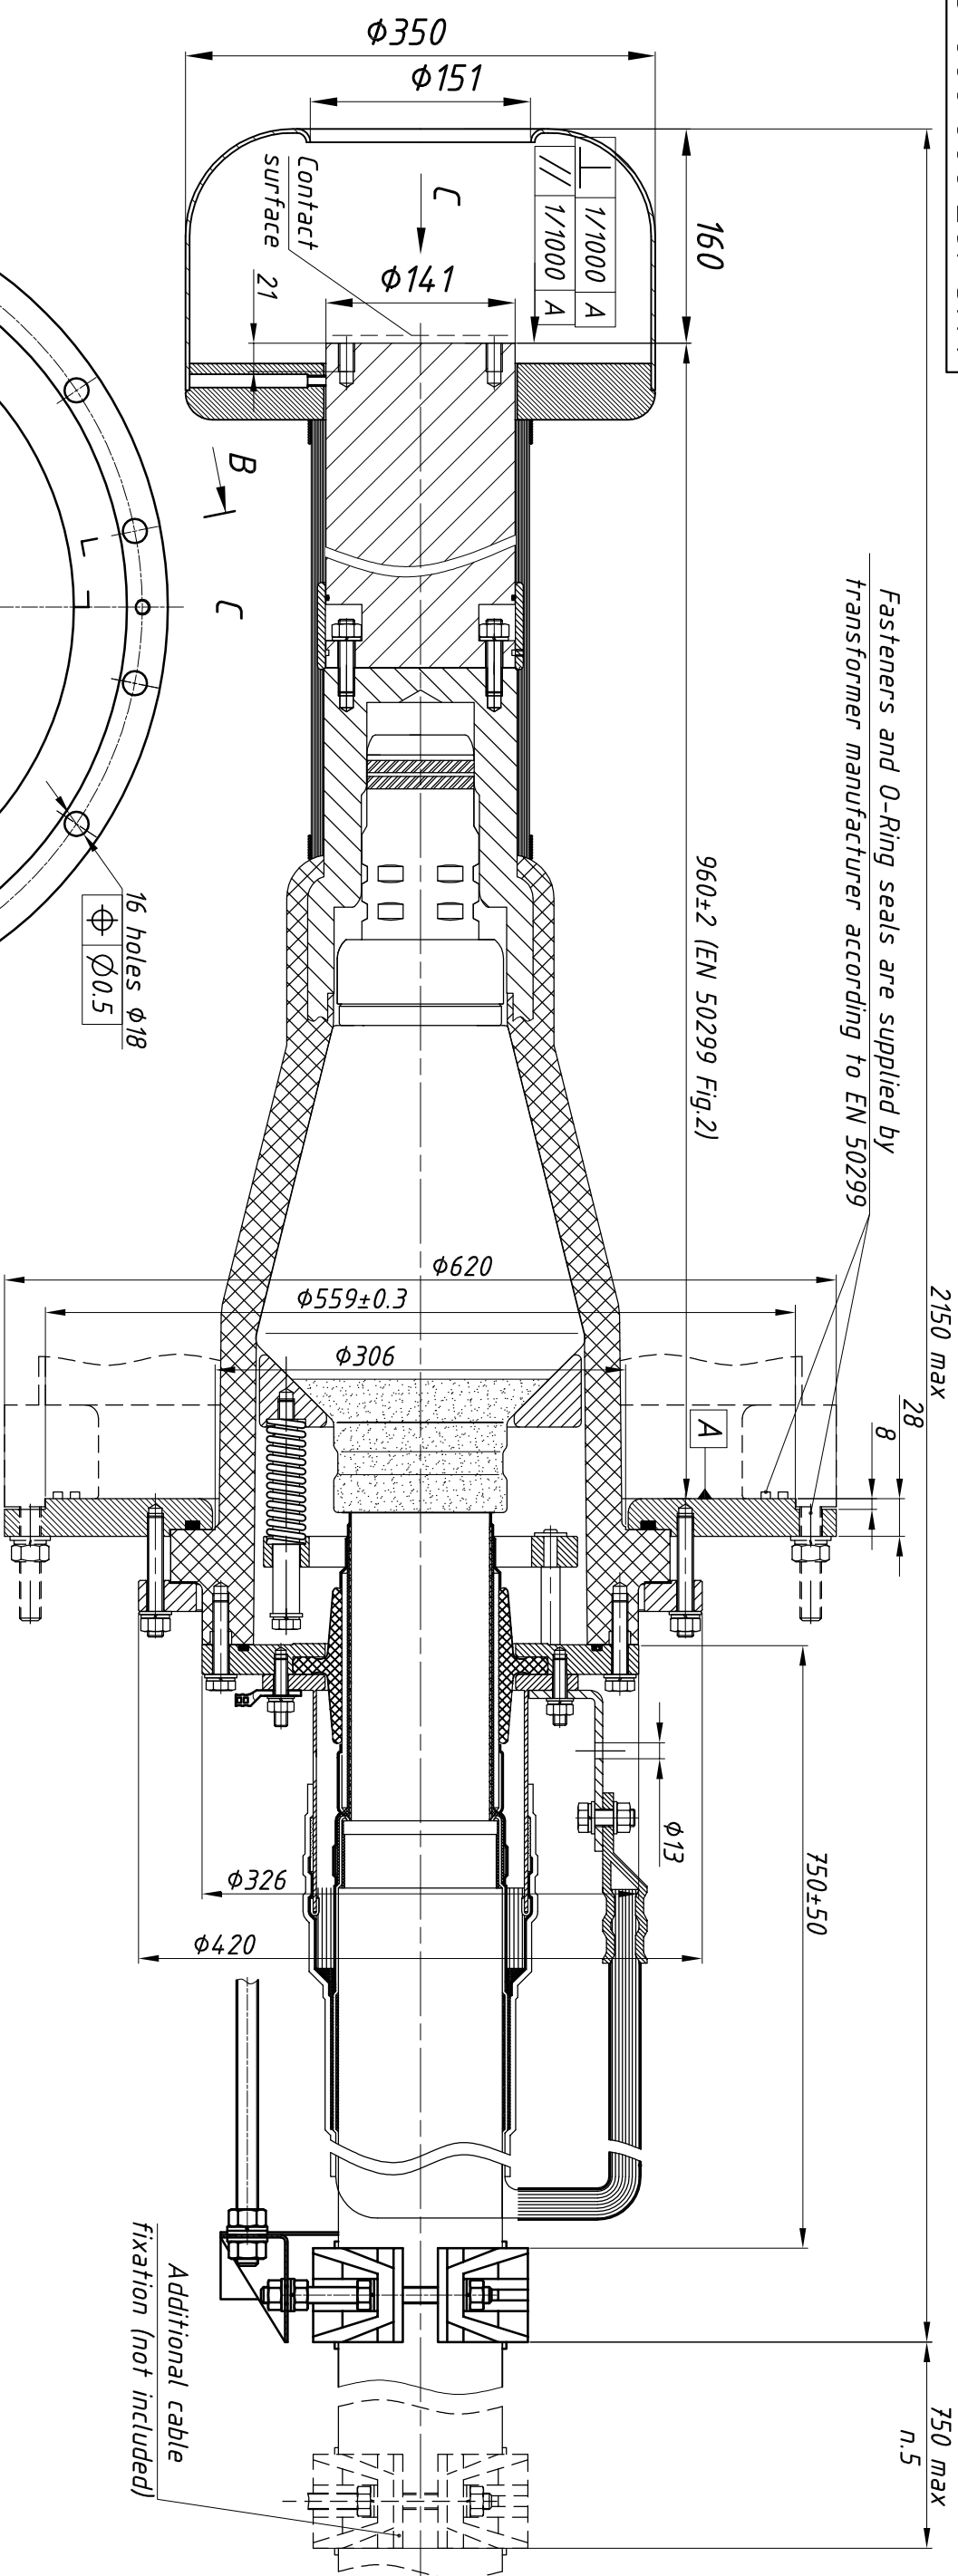

1. Dimensions and scope of supply according to EN 50299.
2. Conductor cross section range:
Cu 400–2500 mm sq.; Al 400–500 mm sq.
3. Prepared insulation diameter range: 64–112 mm.
4. Overall cable diameter – 130 mm max.
5. Cable has to be additionally fixed on metal framework at least once not further than 750 mm from existing cable clamp. Fixation should be performed coaxially with transformer interface. Kit for additional fixation is not included to the scope of supply.
6. Maximal operating voltage is 252 kV.

[illegible]