



AKS.001.100.000 SV

Pic.1 Crimp connector

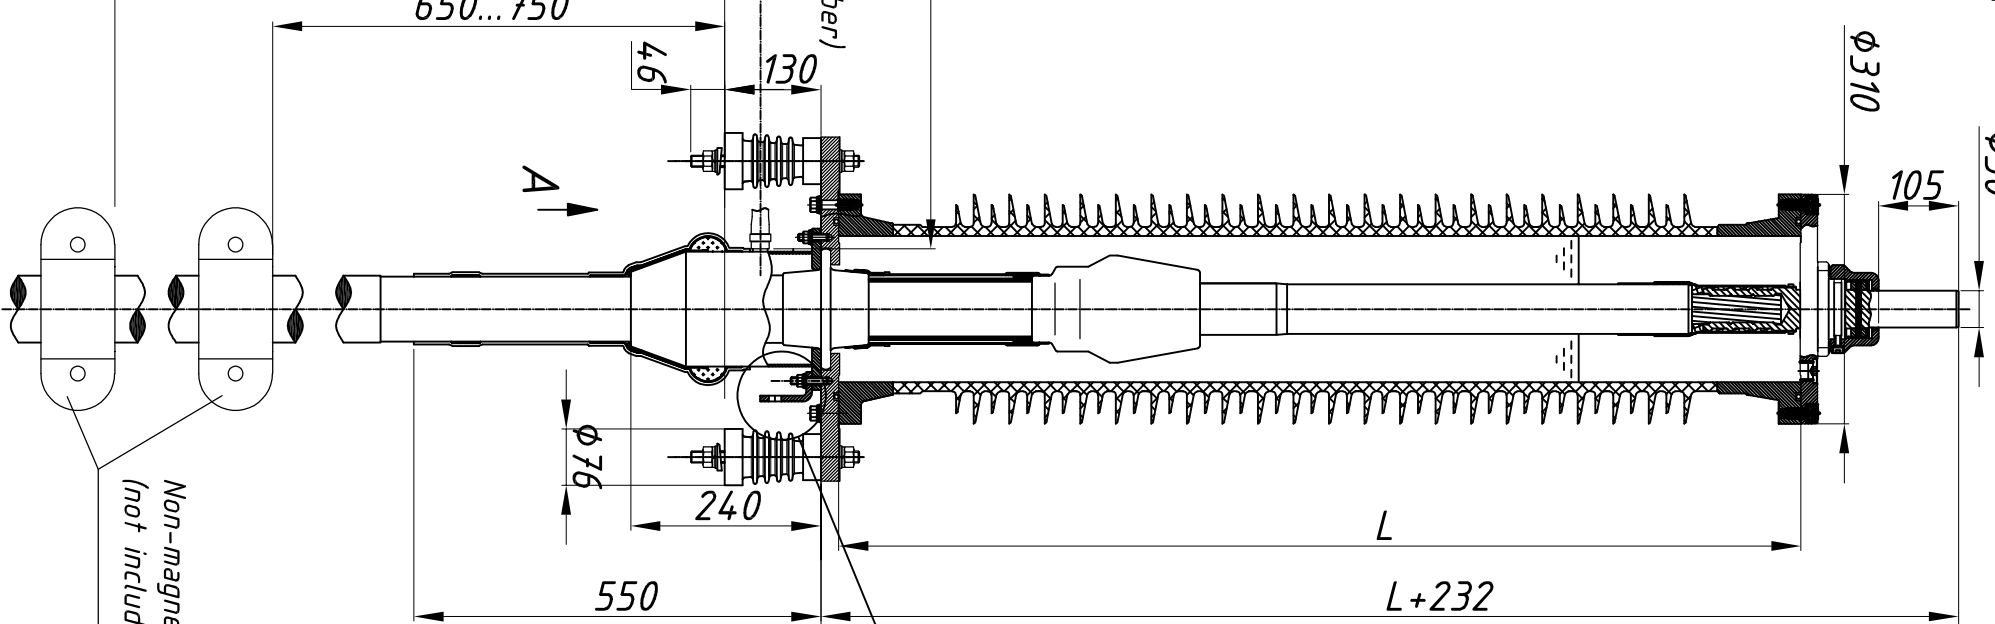

Pic.2

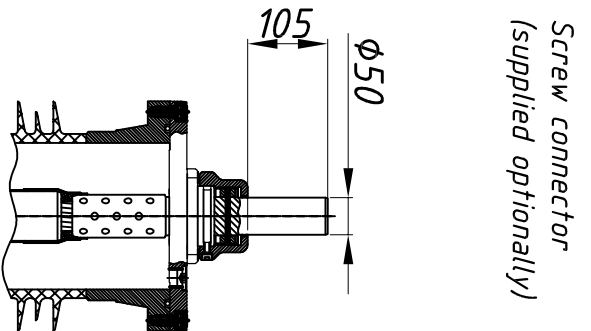

Pic.3

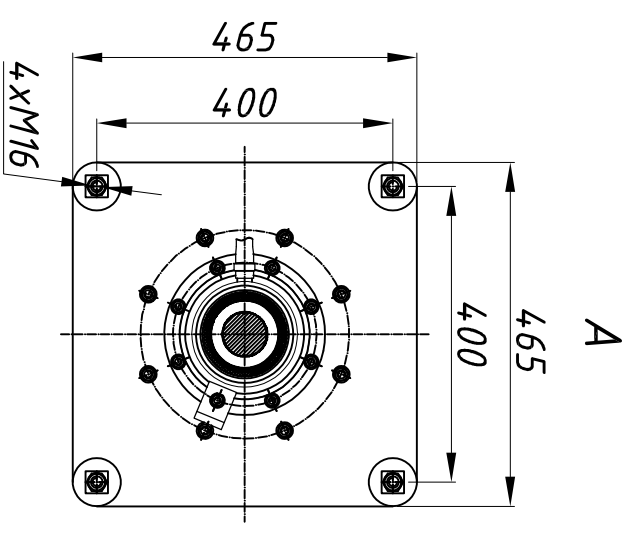
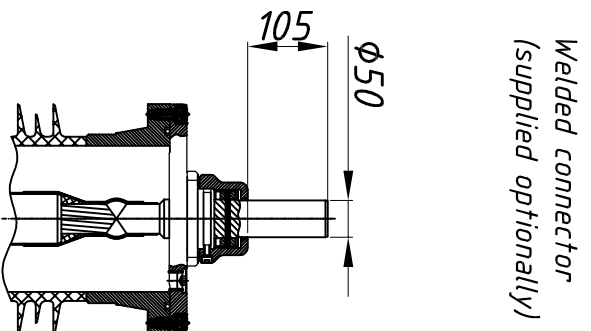


Table 1

Name	Pollution level IEC 60815	Minimal creepage distance, mm	L, mm
MKB 126 (0)	3460	3460	1240
	4025	4025	1240

Table 2

<i>Name</i>	<i>Notation</i>	<i>Performance</i>
<i>MKB 126 (0)</i>	-	<i>Pic.1</i>
	<i>B</i>	<i>Pic.2</i>
	<i>M</i>	<i>Pic.3</i>

<i>Table 3</i>	

Screen section, mm2	φC
up to 185 included	φ13
over 185 and more	φ17

					AKS.001.100.000 SV	
Ch. List	№Doc.	Sign.	Date	High-voltage cable termination MKB 126 (O) Simple view		
Develop	Kintyukhin		05.04.19			
Check	Terekhov		05.04.19			
Approve	Kintyukhin		05.04.19			
				Lit.	Mass	Scale
				A		1:10
				Page	Page 1	
Arkasil SK LLC						